


NOTE: The front side bearing fixing is ensured after the mounting of the pump. The other bearing is free.



CODE	V	kW	RPM	Rate	Rot	IP	Curve
HM.22000	24	2,0	2300	S2-2min	CWDE	IP44	fig.2

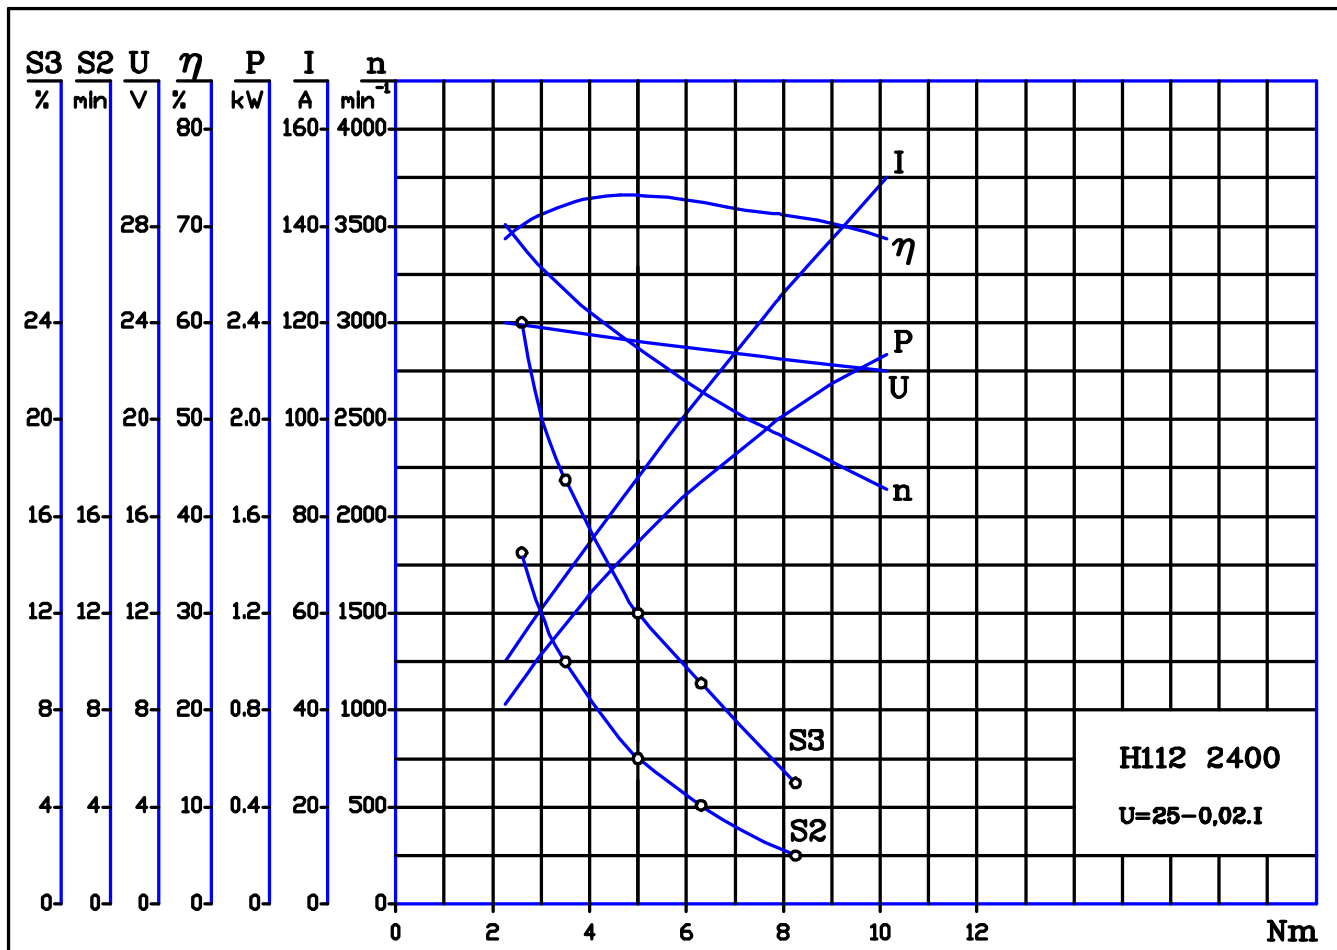


fig.2